



TOP SECTION

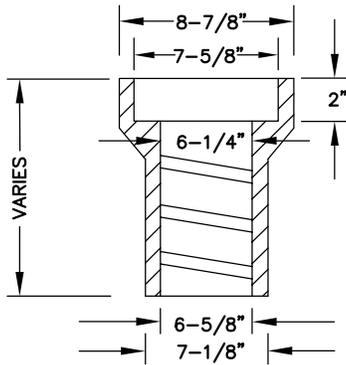


7.5' MINIMUM COVER REQUIRED OVER TOP OF WATER MAIN

FINISH GRADE





DROP LID



ADJUST TOP TO 1/2" BELOW GRADE. BOX TO BE SET TO PROVIDE 12" OF ADJUSTMENT



EXTENSIONS

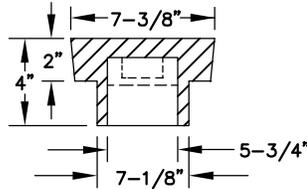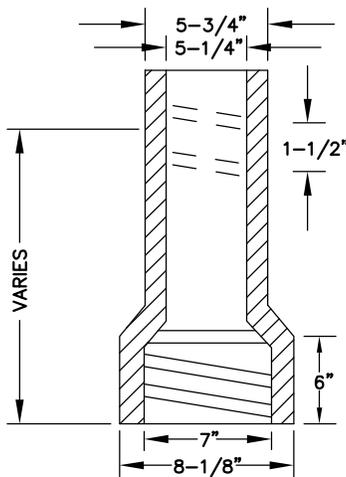


RESTRAINT FITTING (TYP.)

BUTTERFLY VALVE (12" OR LARGER)

BOTTOM SECTION

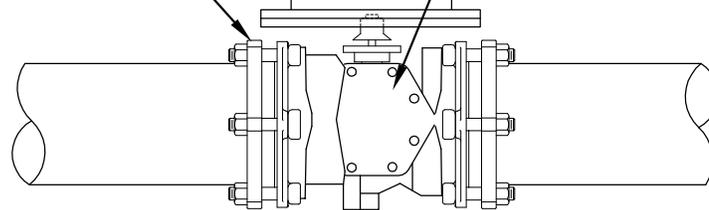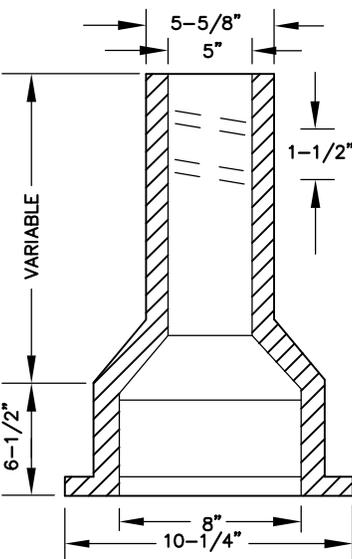

END VIEW



NOT TO SCALE

NOTES:

ALL SECTIONS SHALL BE TYLER 6860 G OR SIGMA VB261 OR VB268 WITH 1/4" WALL THICKNESS

ALL BOLTS INCLUDING T-BOLTS SHALL BE COR-BLUE OR STAINLESS STEEL 316 GRADE

DROP LID SHALL EITHER BE A TYLER NO. 6865 OR SIGMA LABELED WATER

NO SCREW IN TOP SECTIONS OR ADJUSTING RINGS ARE ALLOWED



LAST REVISION
NOVEMBER 2014

**BUTTERFLY VALVE AND BOX
INSTALLATION**

CITY OF MAPLE GROVE ENGINEERING
& PUBLIC WORKS DEPARTMENTS

STANDARD
PLATE #
WM-3